


1/4" X 11" X 6"
DRAIN TROUGH

STREET SIDE

GROUND ROD

ALL DUCTS SHALL BE CENTERED
WITHIN RECTANGULAR AREA.

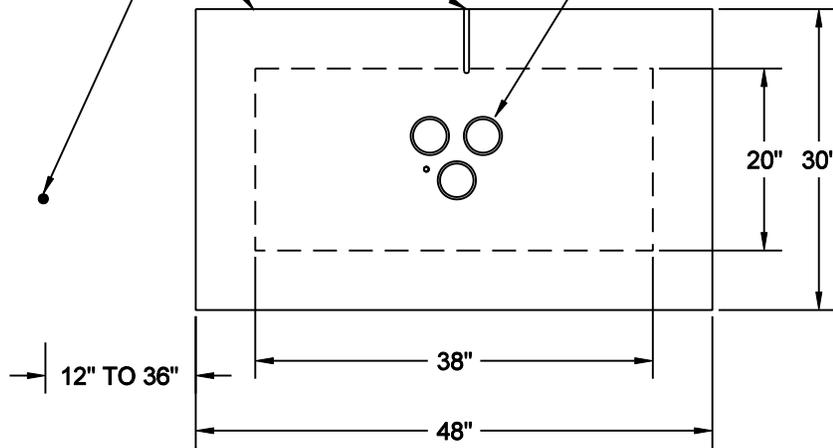


#6 SOLID BARE COPPER TO
GROUND CLAMP W/ 36" TAIL

1/2" NMC

FELT JOINTS
AS REQ'D

ELEC. DUCTS
AS SPECIFIED

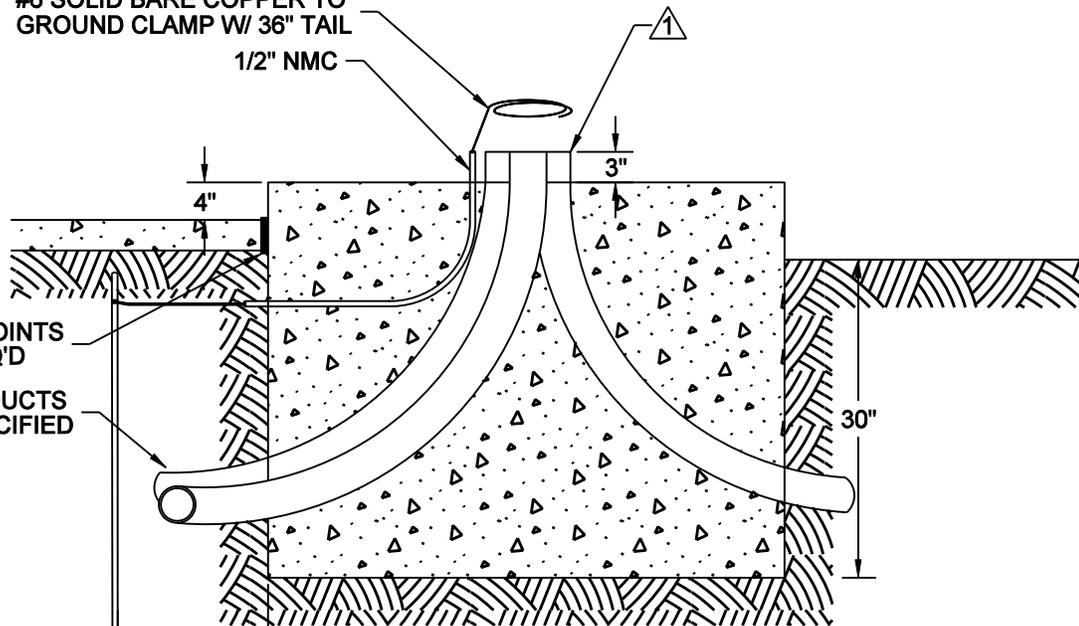

1/2" x 8" GROUND ROD
(WEAVER 8' OR EQUIV.)

NOTES:

- 1 PROVIDE PROTECTIVE BUSHINGS ON ALL CONDUITS
- 2 FOUNDATION TOP SHALL HAVE SQUARED EDGES.
- 3 ALL FOUNDATION LOCATIONS SHALL BE DETERMINED IN FIELD BY TRAFFIC DIVISION AT TIME OF CONSTRUCTION.
- 4 CABINET ANCHORS ARE HILTI KWIK BOLT II WEDGE ANCHORS OR EQUAL 4 PER CABINET, 1/2" X 4 1/2" STAINLESS STEEL (#304) FULL THREADED.

NO SCALE



MINNEAPOLIS
DEPARTMENT OF PUBLIC WORKS

DRAWN: LPK

DATE: 1/1/11

APPROVED: DRP

DATE: 1/1/11

FOUNDATION - SIGNAL
CONTROLLER CABINET TYPE "P"

STANDARD
PLATE
NO.
TRAF-1068