


METER SOCKET SIGNALS

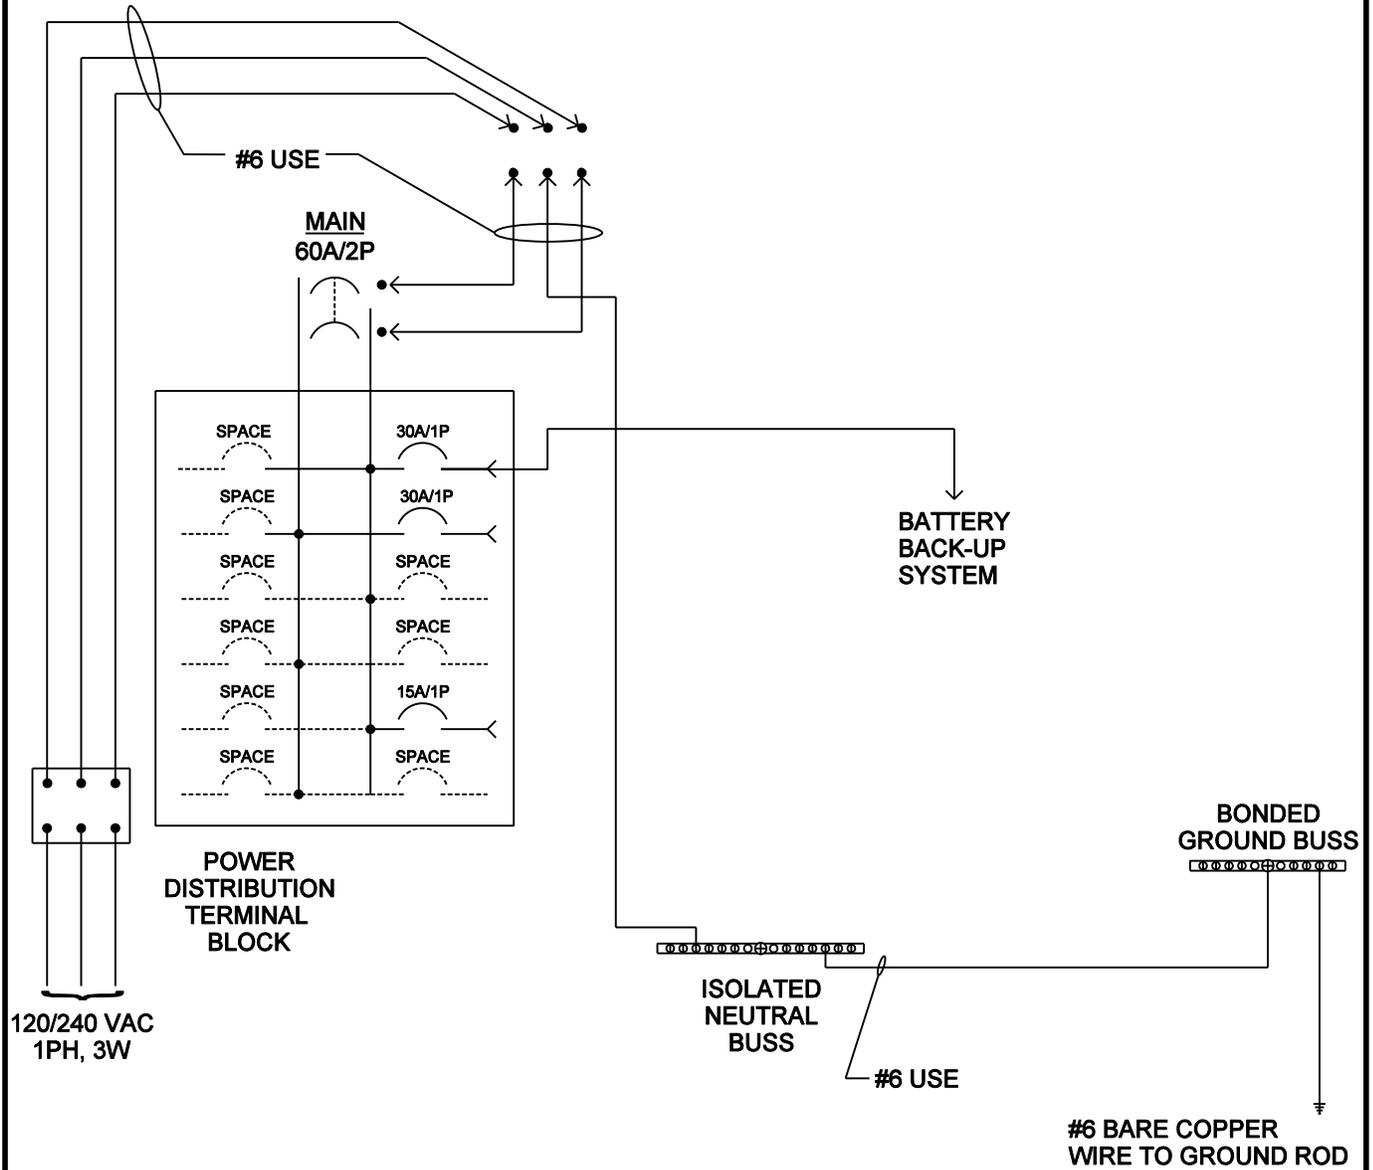

NOTES:

1. TYPICAL INSTALLATION SHOWN, COMPONENT SIZE MAY VARY.
2. LOAD CENTER AND BREAKERS SHALL BE SQUARE D.
3. COMPONENT PARTS IDENTIFIED ARE CITY OF MPLS. STANDARD.
4. WIRE DESIGNATION: MTW= MACHINE TOOLWIRE, USE= RHW-8/USE-8.
5. SEE MPLS. STD. PLATE TRAF-1472 FOR CABINET LAYOUT.
6. ALL TERMINAL BLOCKS SHALL BE INSTALLED IN LOWER HALF OF ENCLOSURE.
7. NEUTRAL AND EQUIPMENT BUSSES SHALL BE BONDED AND ACCOMMODATE UP TO #6 WIRE SIZE.

NO SCALE

	MINNEAPOLIS DEPARTMENT OF PUBLIC WORKS		WIRING - SIGNAL SERVICE / UPS CABINET GROUND-MOUNT NON-CBD REFERENCE PLATE: TRAF-1472	STANDARD PLATE NO. TRAF-1574
	DRAWN: CLK	DATE: 4/15/11		
	APPROVED: DRP	DATE: 4/18/11		